

WATER POLLUTION  
SUBDIVISION PLAN  
FOR  
MADELINE MAILET  
IN

SEABROOK, N. H.

SCALE: 1" = 50' Nov. 2, 1982



CHARLOTTE DURA-DESIGNER L.L.C. No. 5  
RYE, N. H.

THURS 7:00


TOCKYS  
COPY

SOIL TYPE: MK  
SEE R.C.S.B. SHEETS 50 & 51.


SUB AREA#  
1799D

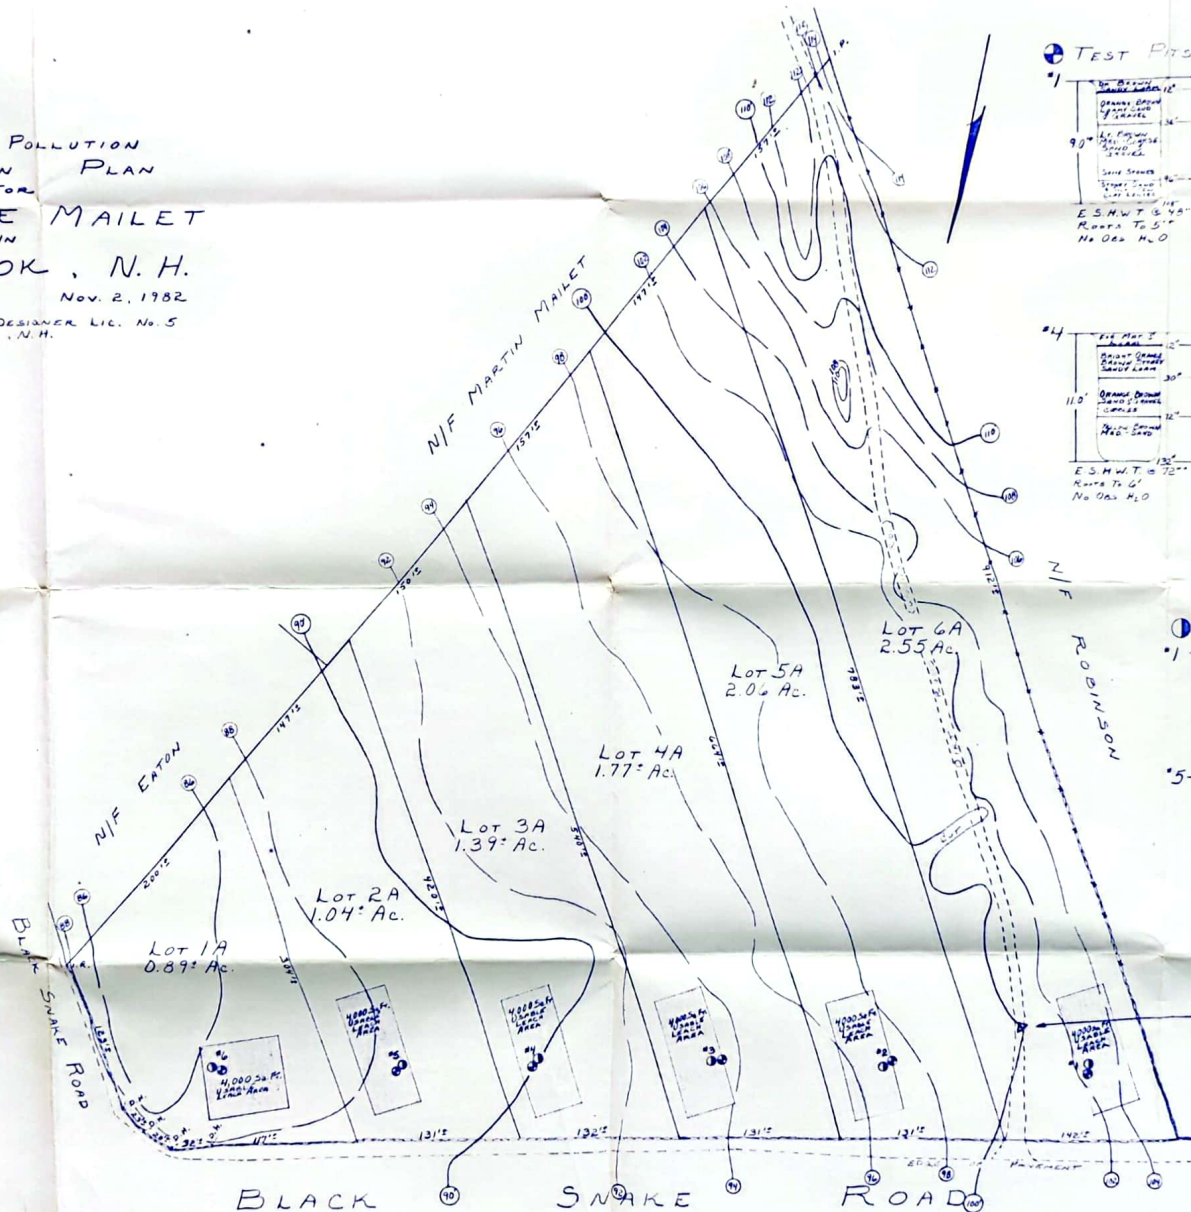

TEST PITS: DATE: 10/30/82

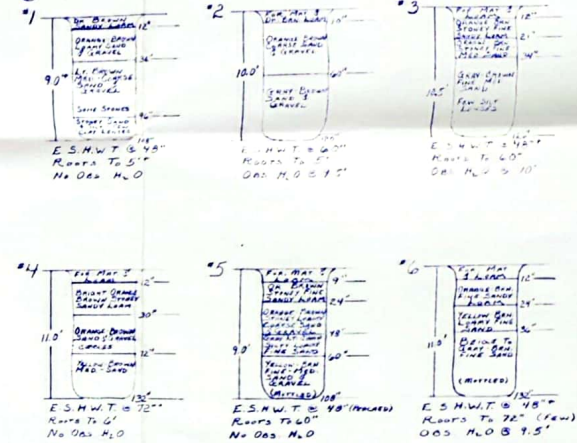

PERC. TESTS: DATE: 10/30/82

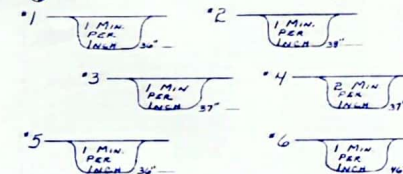

BENCH MARK: 100.0' ASSUMED  
TOP OF HUB.



# APPROVAL FOR CONSTRUCTION

THE PLANS AND SPECIFICATIONS FOR SEWAGE OR WASTE DISPOSAL SYSTEM SUBMITTED FOR:

APPROVAL # 120425

Owner:

Lorraine Noble  
85 Broadway  
Methuen, MA 01844

LOT NUMBERS: 6A  
SUBD. APPL. #: 17990  
SUBD. NAME:

Copy of Plan & Approval sent to:

Board of Selectmen  
Town Office  
Seabrook, NH 03842

TYPE OF SYSTEM: Four bedrooms

TOWN/CITY LOCATION: Seabrook, NH  
STREET LOCATION: Blacksnake Rd.

By Applicant: PERMIT # 348

Anne Bialobrzewski  
247 Landing Rd.  
Hampton, NH 03842

PLEASE POST IN A CONSPICUOUS PLACE DURING CONSTRUCTION.

THIS APPROVAL DOES NOT SUPERCEDE ANY EQUIVALENT OR MORE STRINGENT LOCAL ORDINANCES OR REGULATIONS. STATE STANDARDS ARE MINIMAL AND MUST BE MET STATEWIDE.

WHITE= Applicant's; YELLOW= Town's; BLUE= NHWS&PCC file; GOLD= Owner's - (No Action Required)

NOTE: ( XX ) Gravity system ( ) Gravity system to septic tank and effluent pump chamber with disposal system to be constructed on a properly prepared base.

ed bottom to be set: ( XX ) no deeper than 24 " below the original grade ( ) no less than " above the original grade

to maintain ( XX ) 4 ' minimum above (the reported) (any) seasonal high water table. ( ) ' minimum above (the reported) (any) ledge depth.

( ) ' minimum above (the reported) (any) impermeable soil. XX ) Fill to prepare disposal area should be a medium to coarse sand (0.5 to 1.0 mm). ( ) This approval only valid for the above owner's domicile/exemption.

re approved this date:

April 18, 1985

By:

*James Shepard*

James E. Shepard vcg N.H. Water Supply & Pollution Control Commission Staff (OVER)

revised 8/1/80

## PERC TEST

DATE: 4/4/85

DEPTH OF HOLE: 34"

RATE OF PERC: 2 MIN/IN

DESIGN LOADING: 4 BEDROOMS

AREA REQUIRED: 750 SQ. FT.

PROPOSED SYSTEM: 20 x 38 FOR 760 SQ. FT. AREA PROVIDED

### REVIEWED AND APPROVED

IN ACCORDANCE WITH THE REQUIREMENTS OF THE

NEW HAMPSHIRE

WATER SUPPLY & POLLUTION CONTROL COMMISSION

Signed

Date

PLAN OF PROPOSED SEPTIC SYSTEM

LOCUS: LOT 6A, BLACKSNAKE RD  
SEABROOK, NH.

OWNER: LORRAINE NOBLE  
85 BROADWAY  
METHUEN, MA. 01844

APPLICANT: ANNE W. BIALOBRZESKI  
247 LANDING ROAD  
HAMPTON, N.H. 03842  
DESIGNER PERMIT #348

DATE: 4/8/85

APPROVAL:

35

NEW HAMPSHIRE  
Designer  
Of  
Subsurface Disposal  
Systems  
\*\*\*  
Ann W. Bialobrzewski  
No. 348  
Water Supply & Pollution Control Commission

RECEIVED  
APR 12 1985  
WATER SUPPLY & POLLUTION CONTROL COMMISSION